
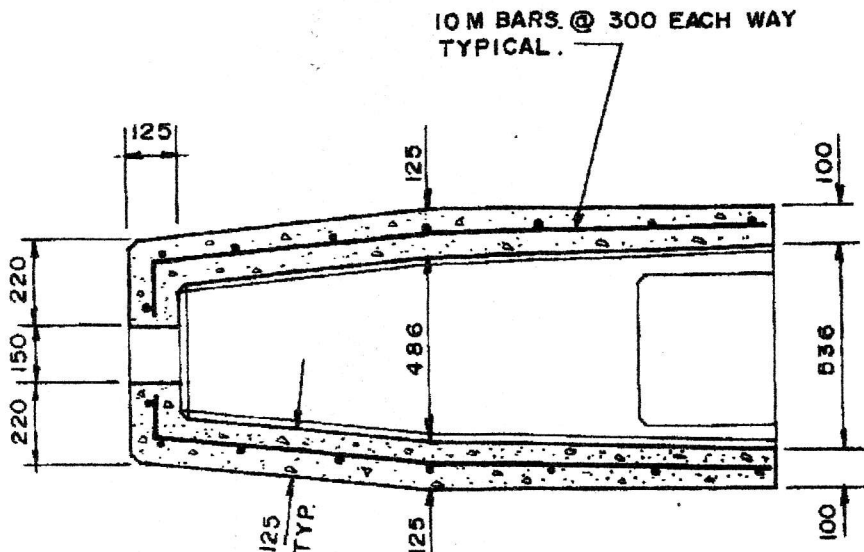


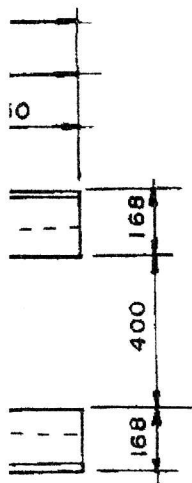

SECTION B-B

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE SPECIFIED
2. REBAR SHALL BE GRADE 300 MPa.
3. ALL CHAMFERS TO BE 25mm. UNLESS OTHERWISE SPECIFIED
4. TOP OF BASE TO PROVIDE A LEVEL BEARING SURFACE
5. CONCRETE STRENGTH SHALL BE 30 MPa AT 28 DAYS
AIR ENTRAINMENT = $5\% \pm 1\%$
MAX. AGGREGATE SIZE = 20 mm.
SLUMP = $80\text{ mm} \pm 20\text{ mm}$
CEMENT = TYPE 50
6. TOTAL WEIGHT IS APPROX. 1800 Kg.

10M BARS @ 300
EACH WAY
TYPICAL.

DRAWING STATUS		H.O. CONCRETE SUPPLIES LTD.				
ISSUED	DATE	PRECAST CONCRETE BASE FOR CONTACTOR / BREAKER OR TRAFFIC CONTROLLER M K 100				
PRELIMINARY						
FOR APPROVAL						
APPROVED FOR CONSTRUCTION						
REVISED & APPROVED FOR CONSTRUCTION AT REVISION		OWN BY F. C.	DATE MAR 25/92	SCALE 1:20	DWG. NO. 1 of 1	ISSUE 1